



APPROX. WEIGHT
(LBS)
62



| ECO No | DESCRIPTION | REV BY | DATE |
|--------|-------------------|--------|----------|
| M12088 | REPLACE CMP W/CMB | MN | 11/07/19 |

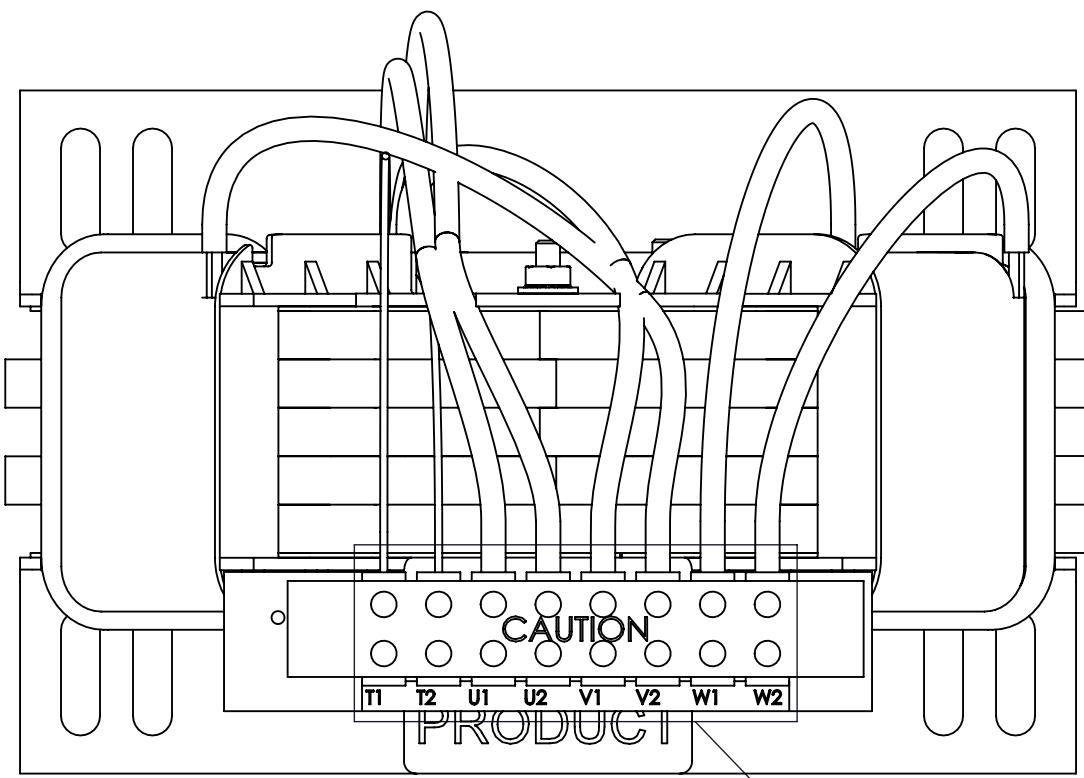


TOP VIEW

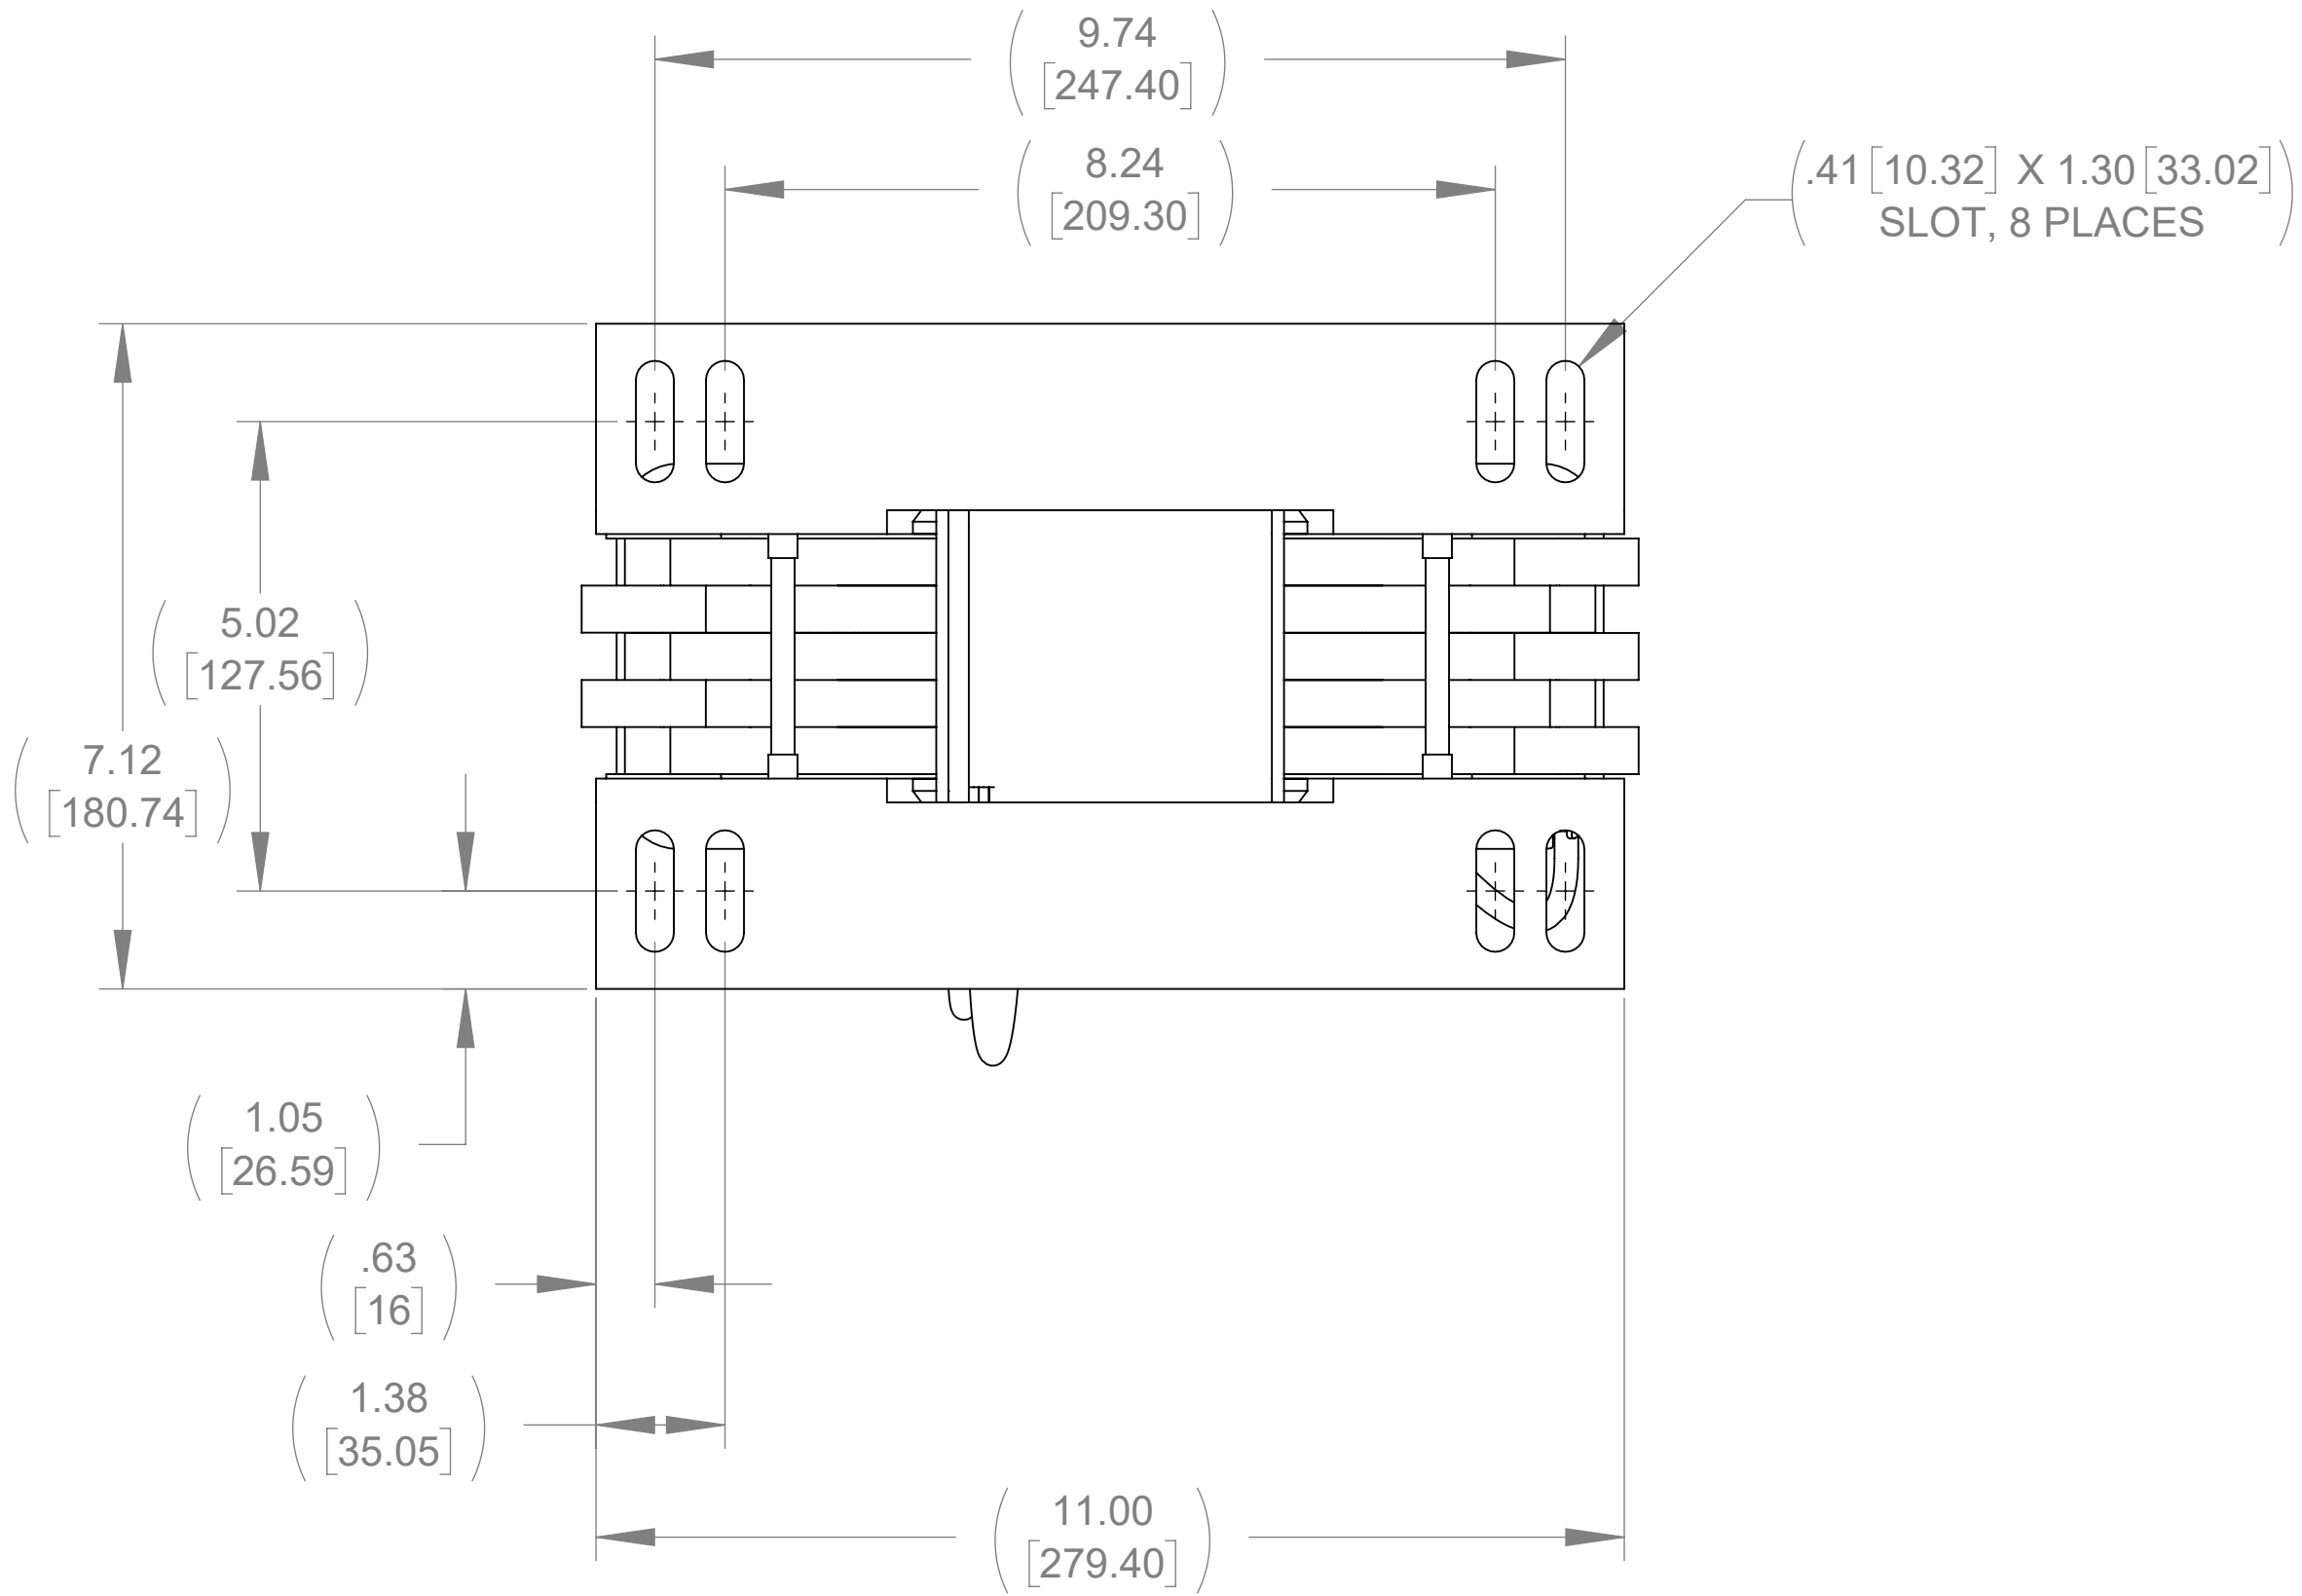


BOTTOM VIEW

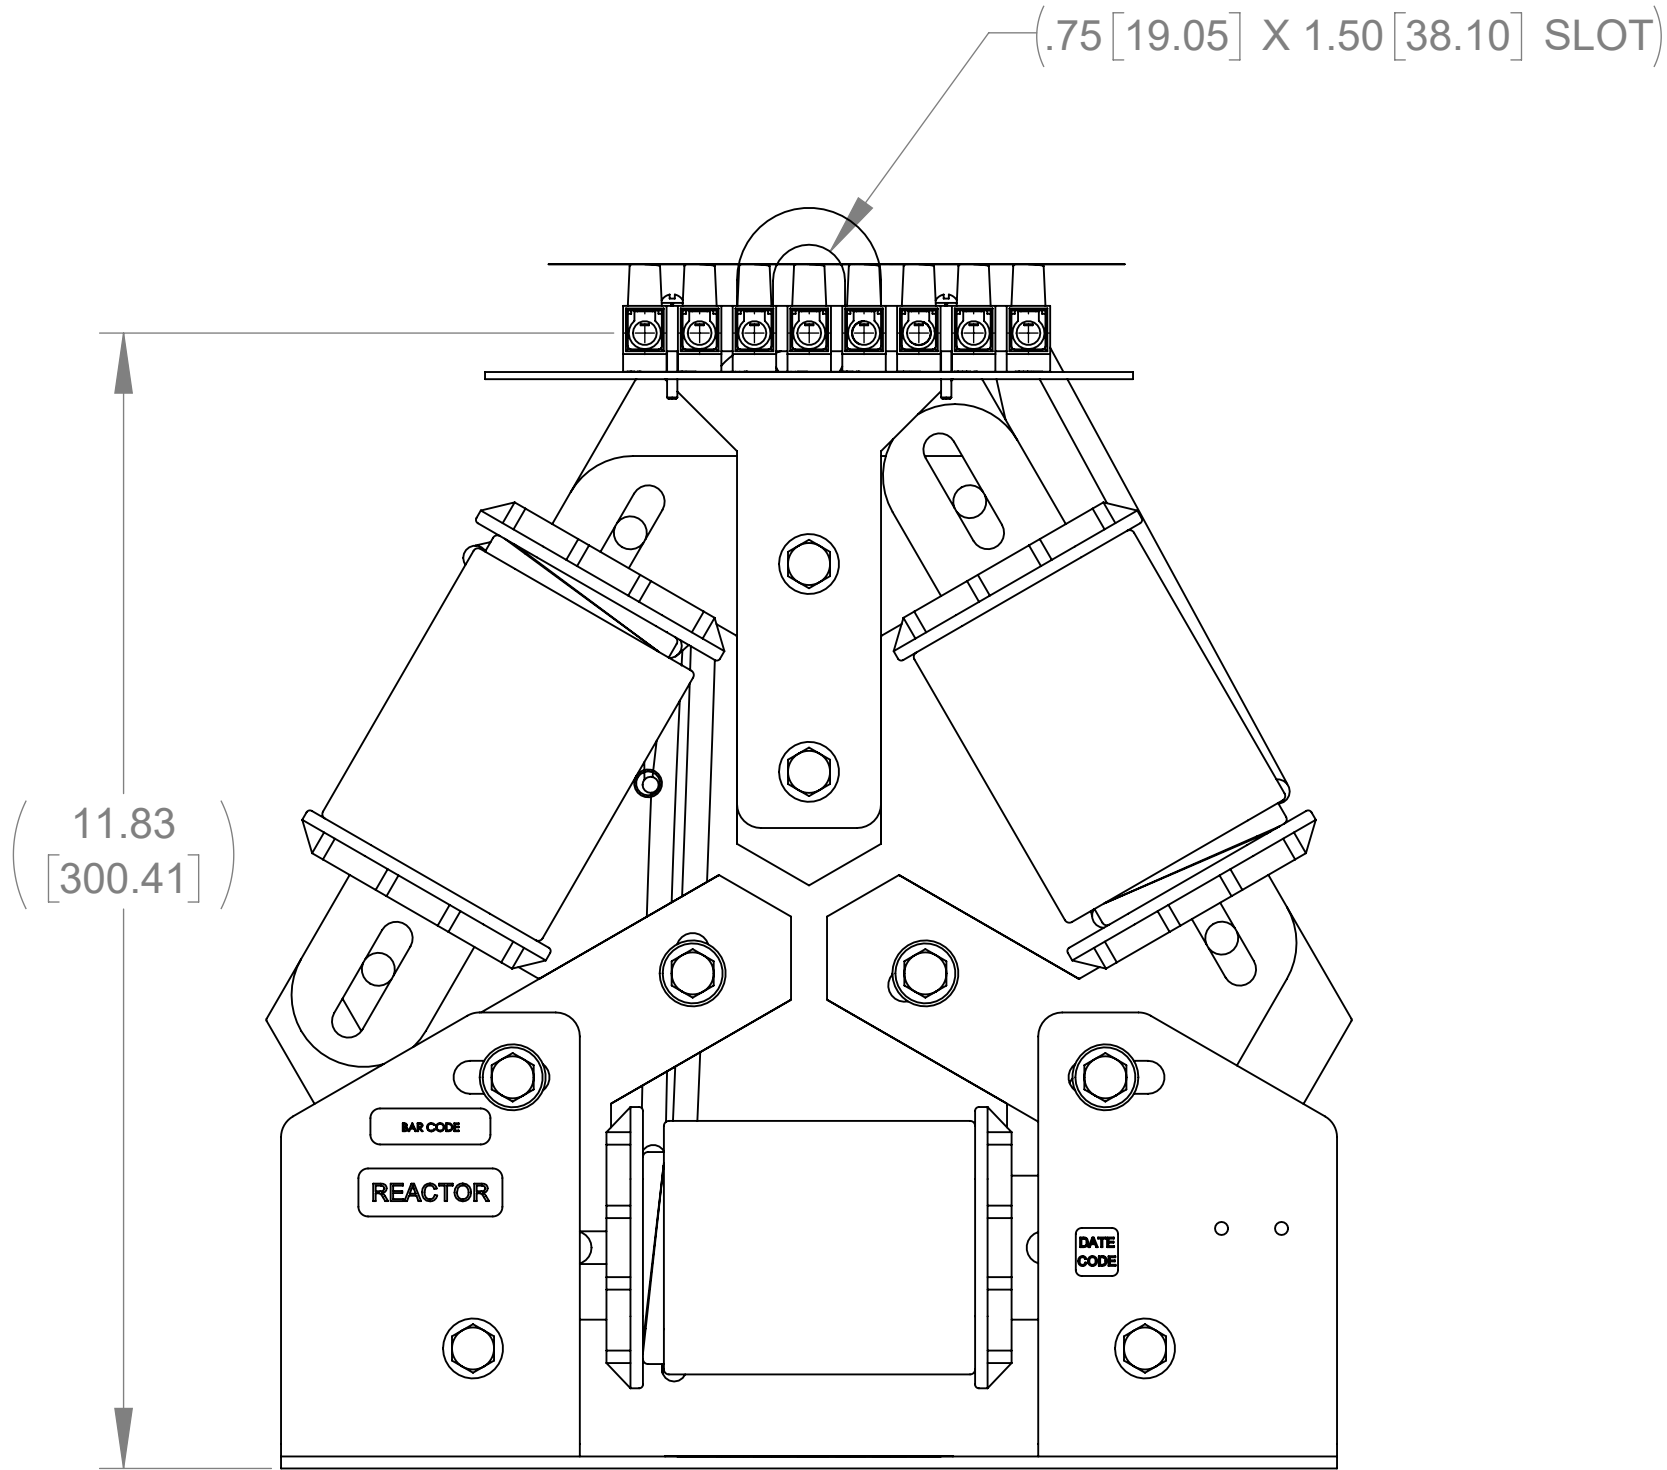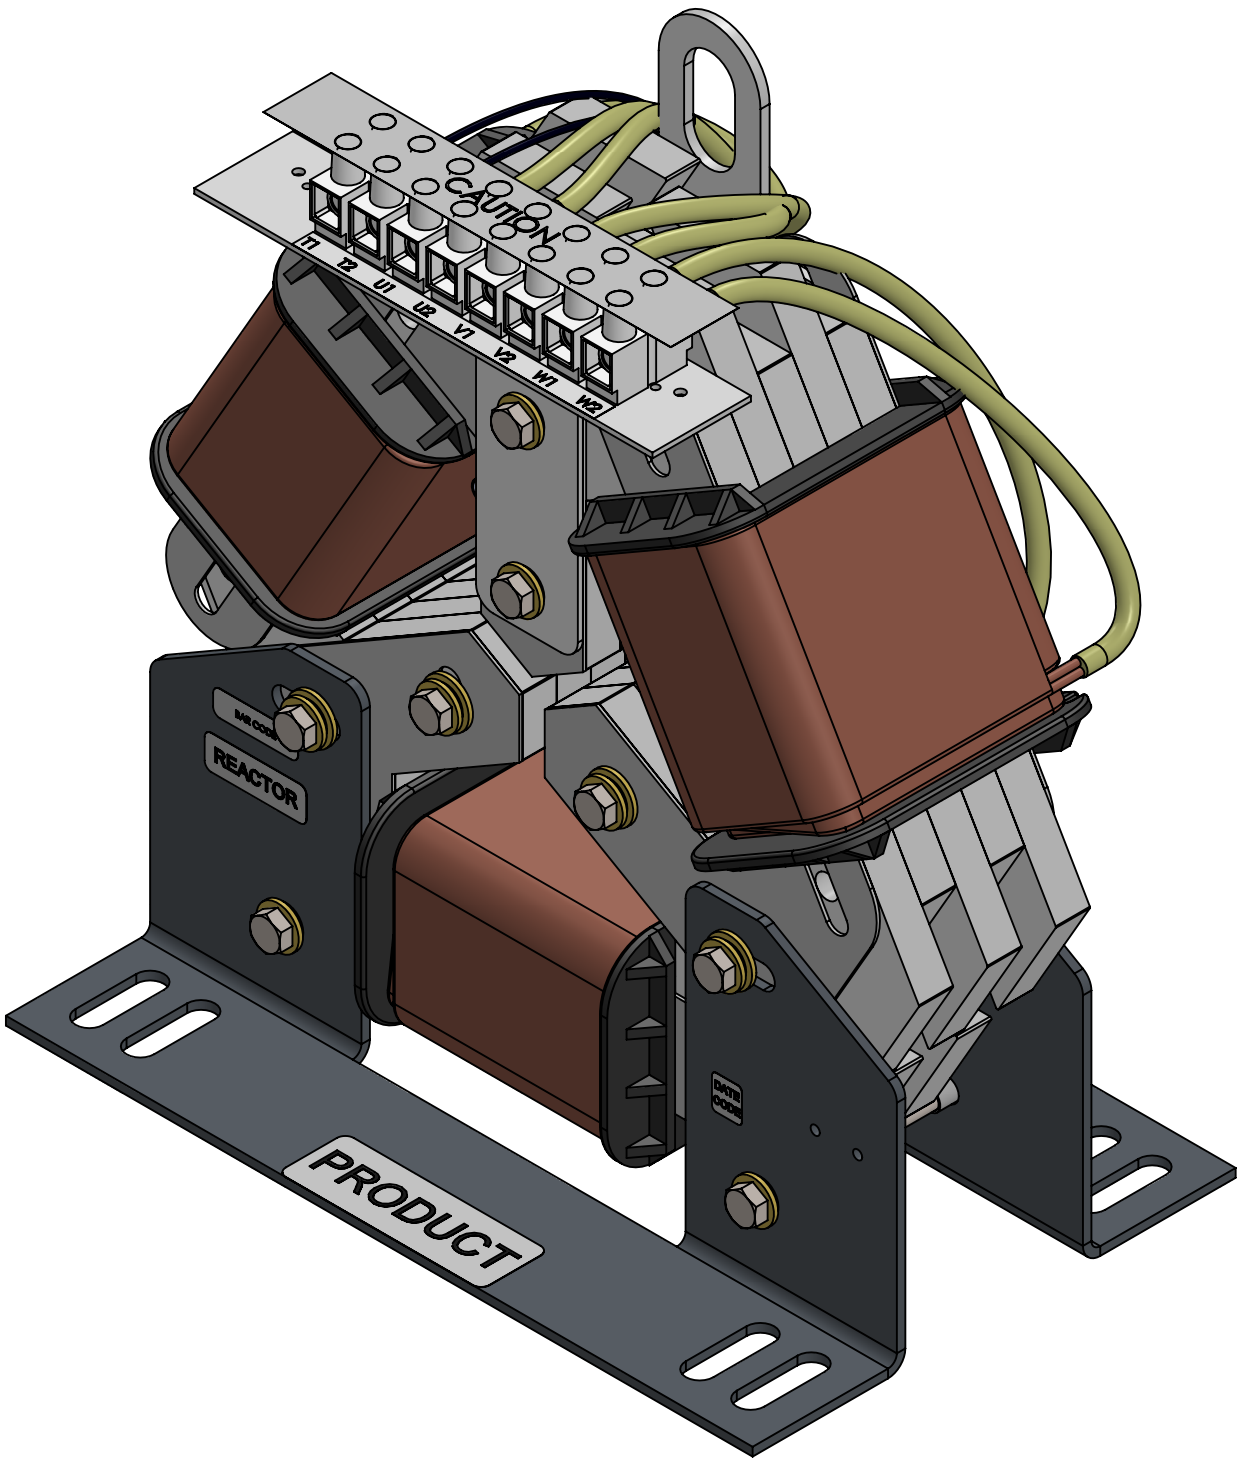

FRONT VIEW

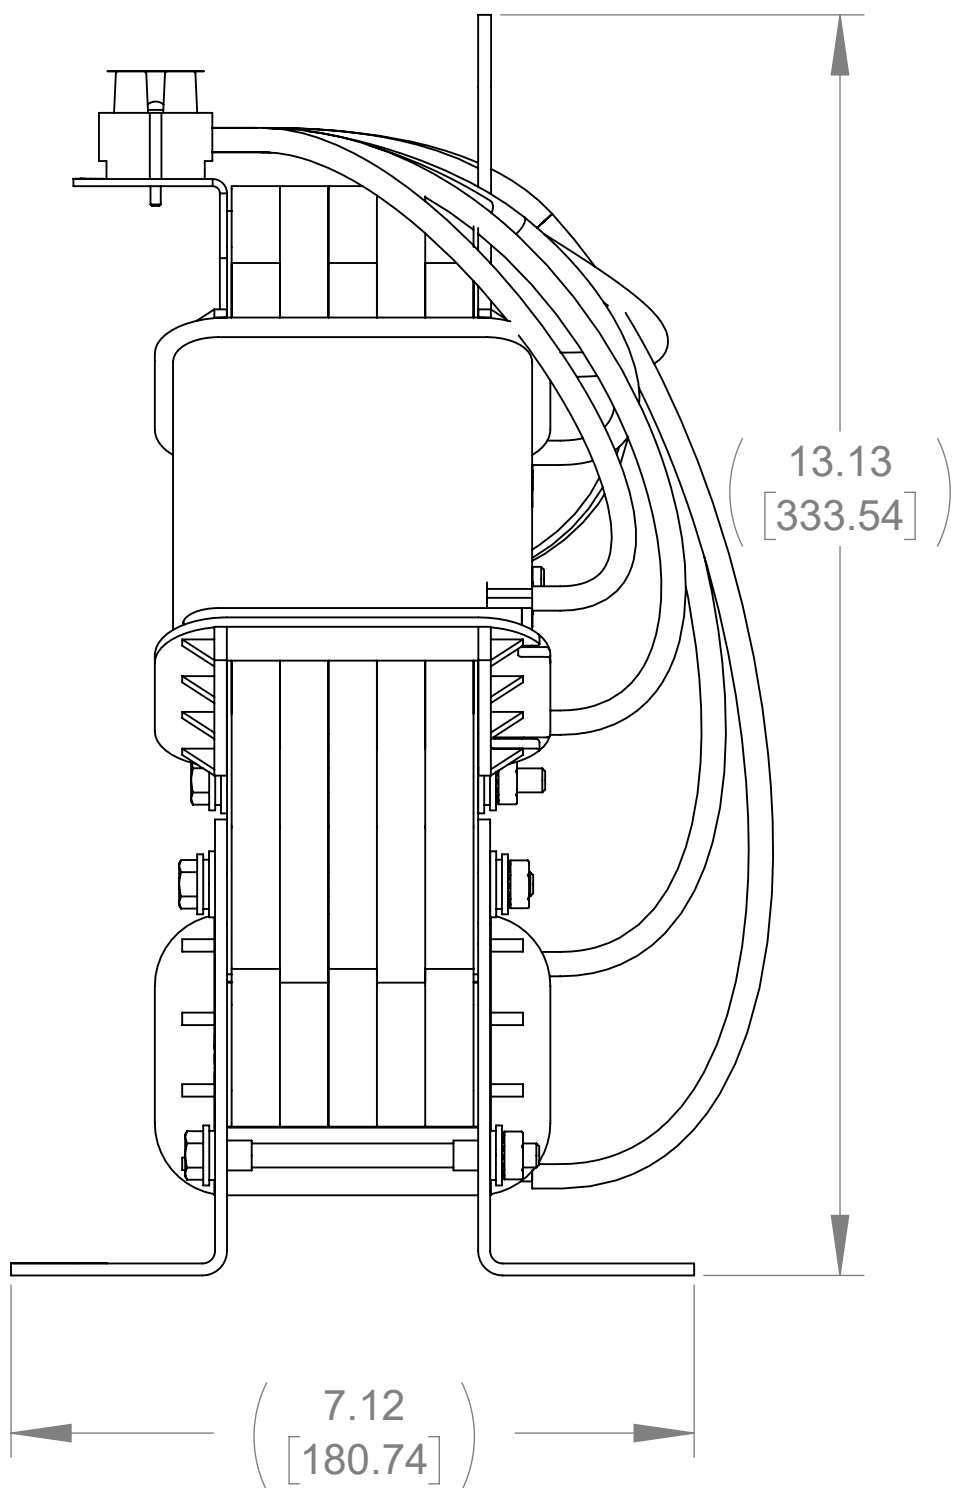

SIDE VIEW

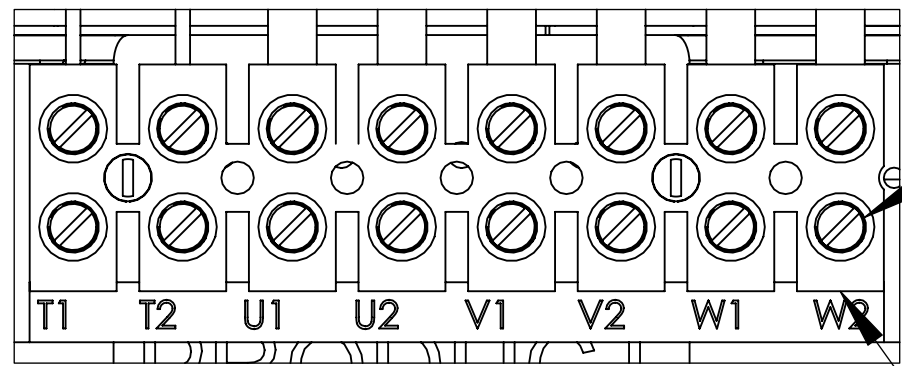

DETAIL A
CUSTOMER CONNECTION
DETAIL VIEW

NOTES:

1. TERMINAL WIRE RANGE: 4-14 AWG.
2. TERMINAL SCREW TIGHTENING TORQUE: 16 IN.LBS.
3. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS.
4. FILTER INCLUDES: CAP-509SW (QTY. 1) AND CMB-005(QTY. 1).

| | | | | | |
|--|--|---|--|--|-------------------------|
| THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2 | | MATERIAL | | CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION | |
| CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION | | | | DESCRIPTION | |
| UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254] | | MTE POWER QUALITY. SOLVED. N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455.4683 262.253.8200 | | SINEWAVE NEXUS FILTER 27A 480V 60Hz OPEN PANEL | |
| DRAWN MN | | DATE 03/21/19 | | SIZE D | DWG No. CD SWNM0027D |
| CHECKED MN | | DATE 11/07/19 | | REV 01 | |
| APPROVED RH | | DATE 11/18/19 | | SCALE 1:2 | SHEET 1 OF 1 |