



APPROX. WEIGHT
(LBS)
67



ECO No	DESCRIPTION	REV BY	DATE
M12094	REPLACED CMP W/CMB	MN	11/21/19

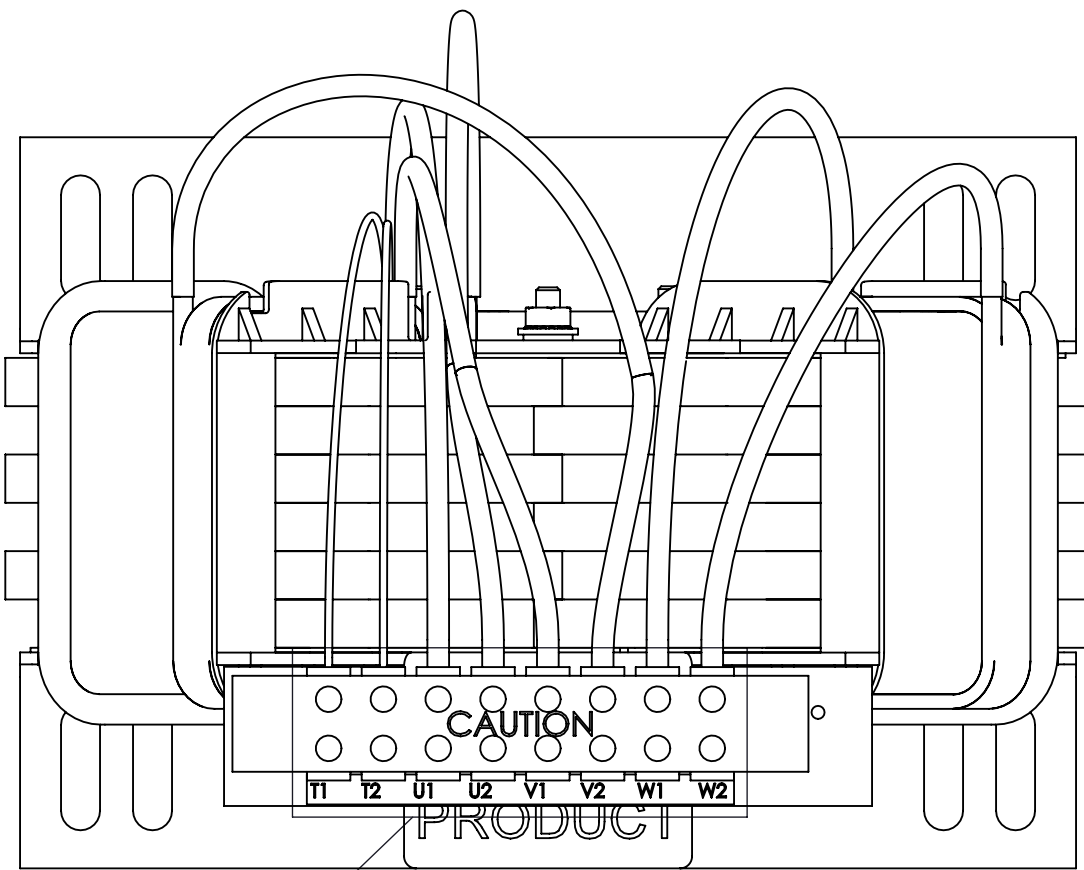


TOP VIEW

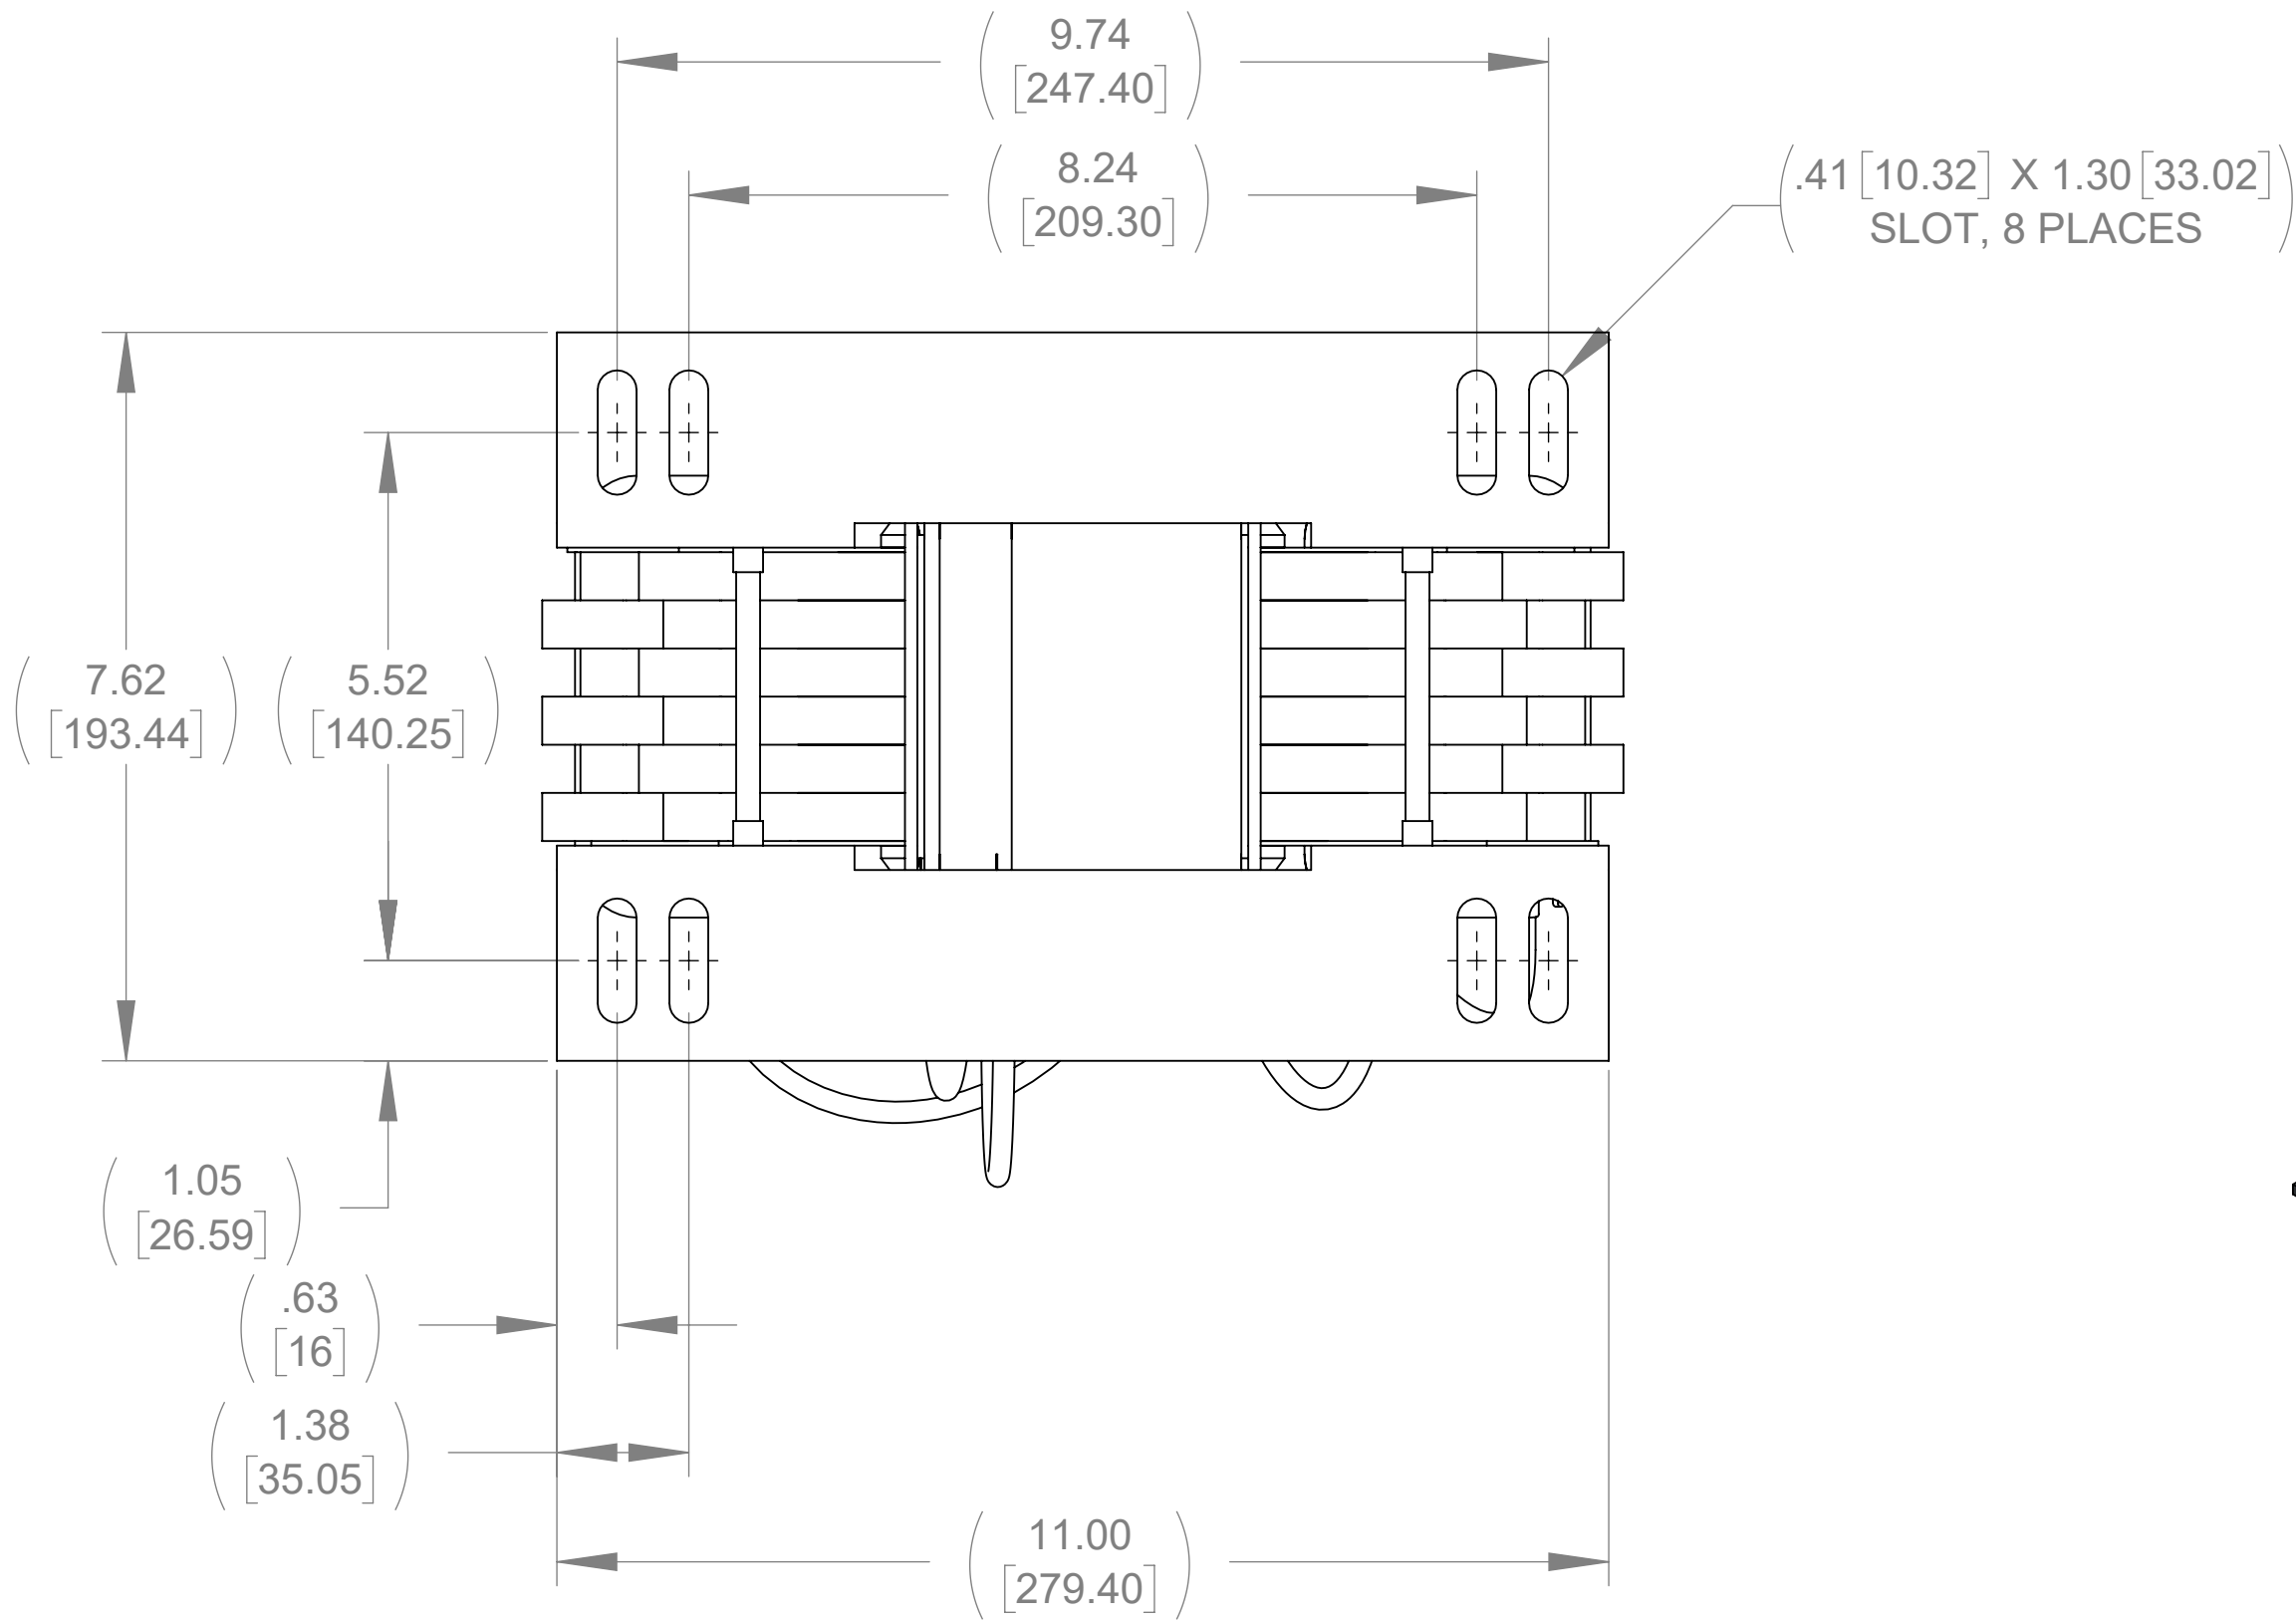


BOTTOM VIEW

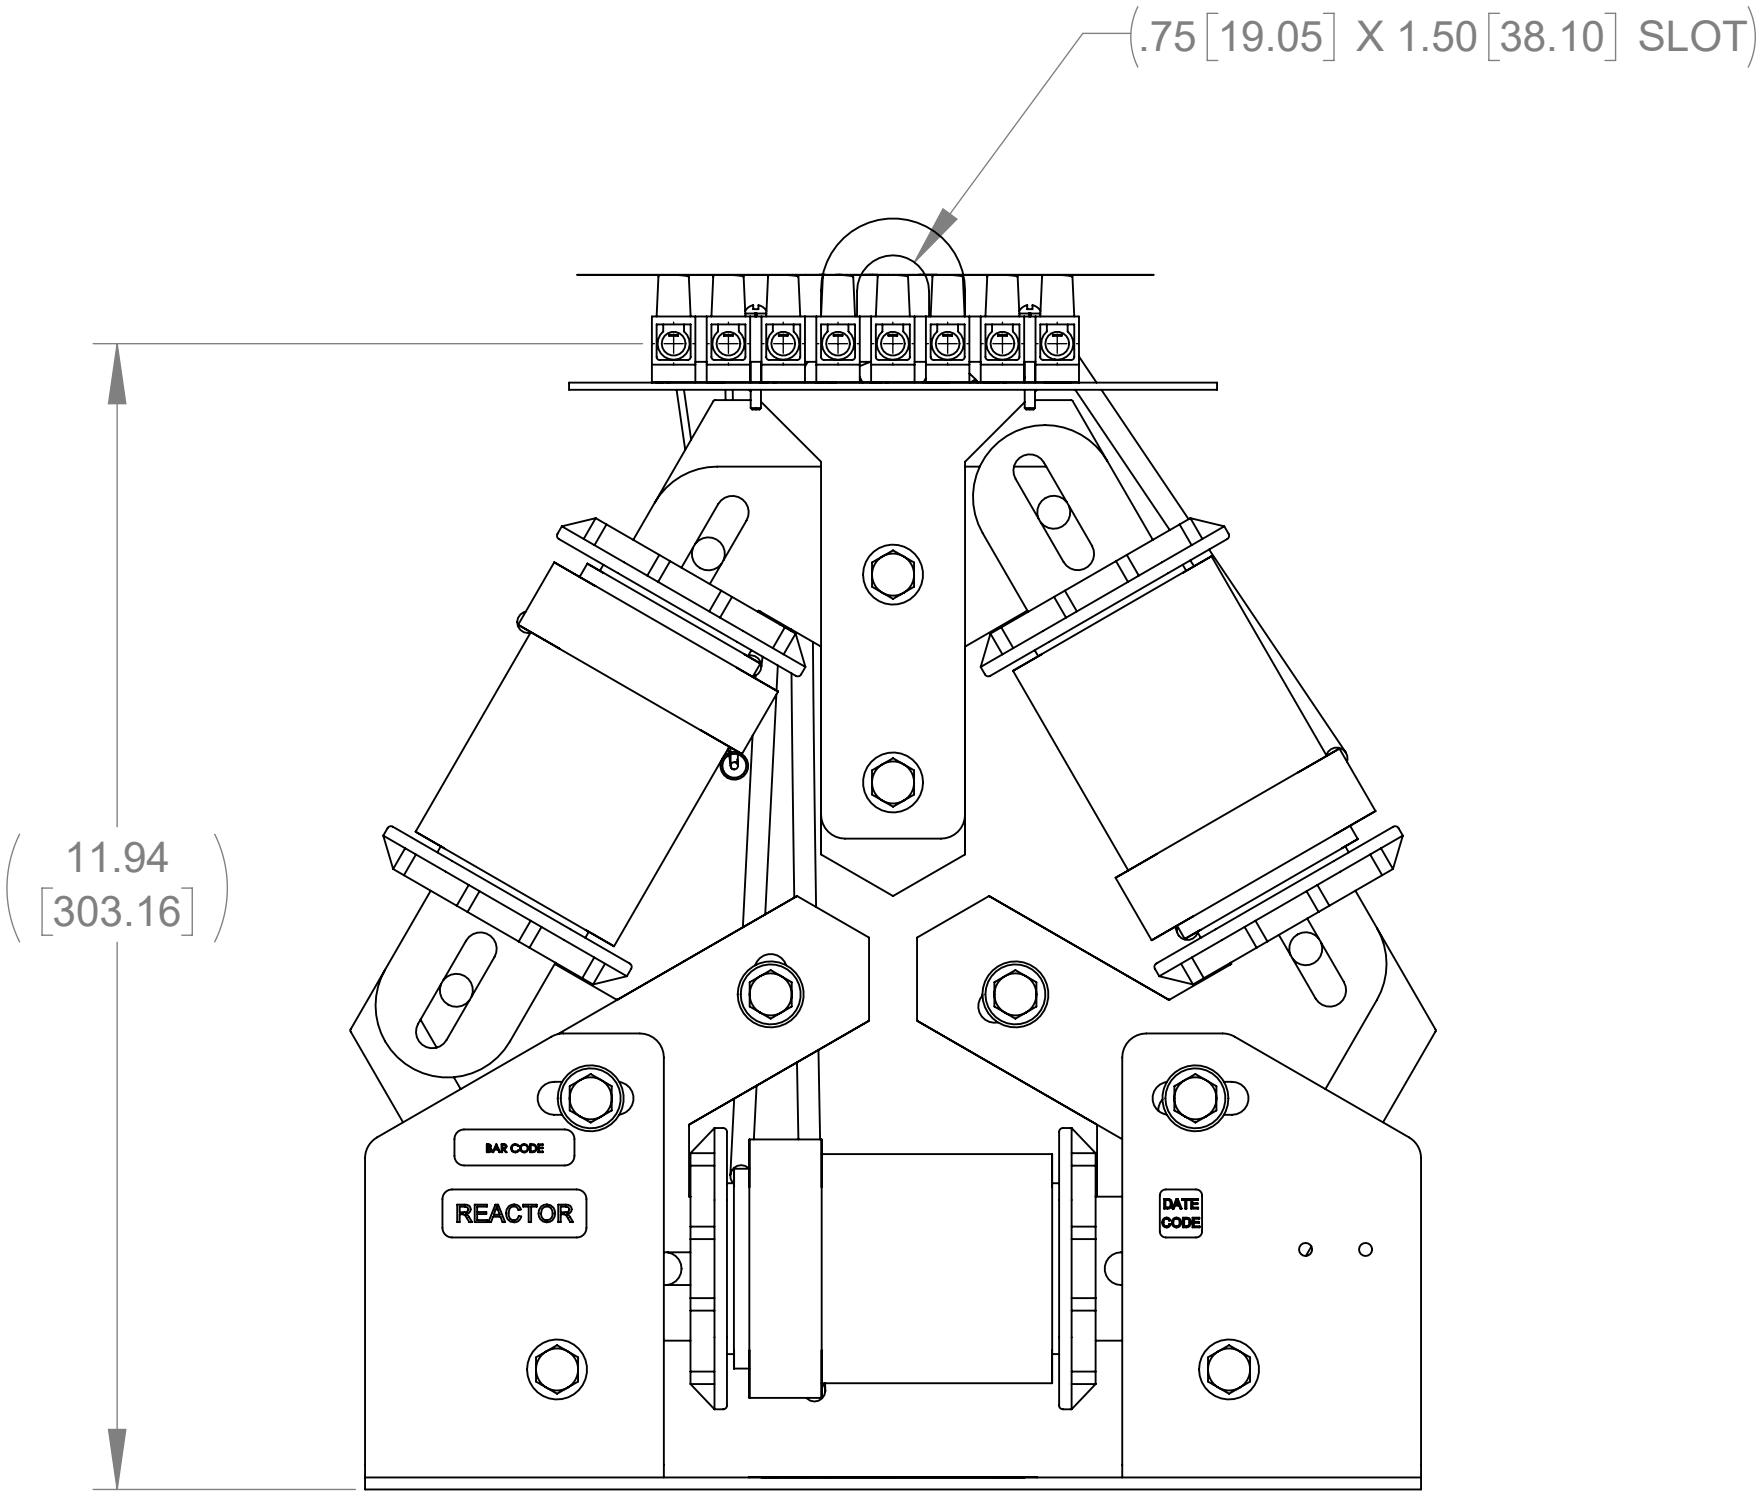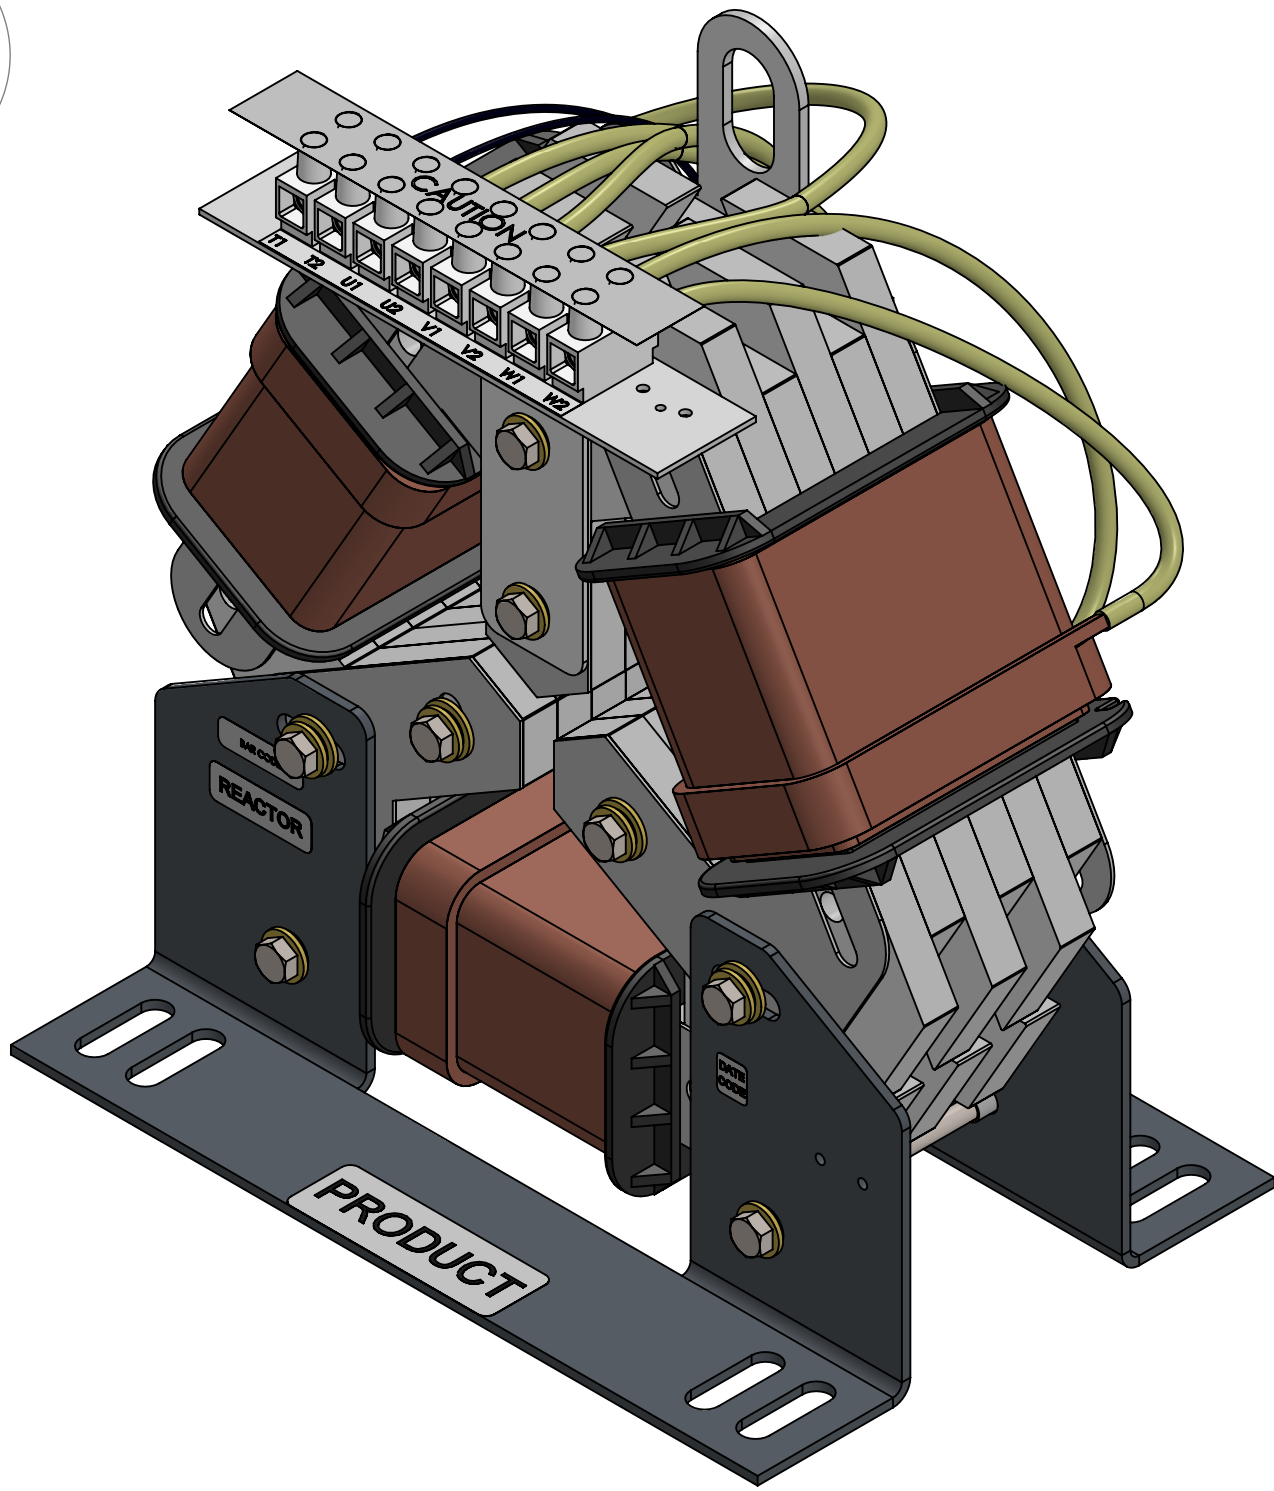

FRONT VIEW

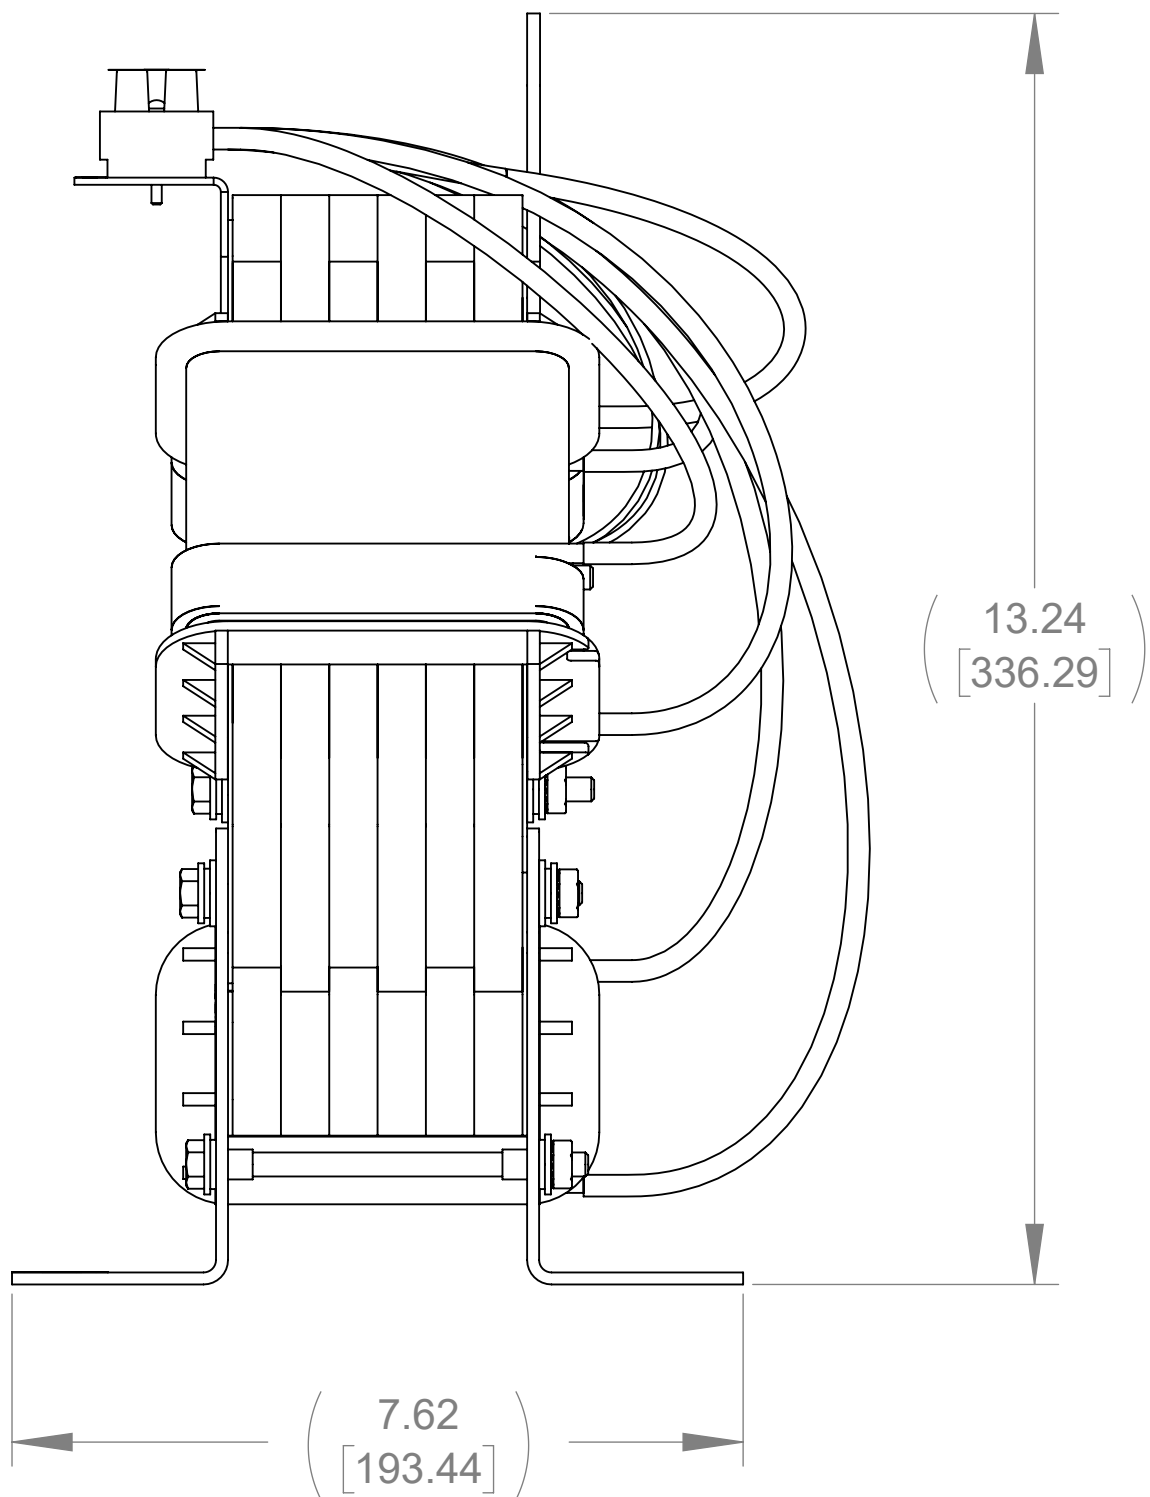

SIDE VIEW

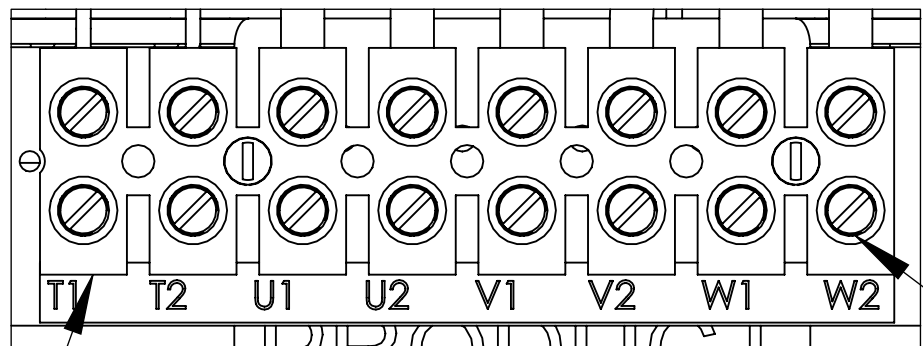


SEE NOTE 1

DETAIL A
CUSTOMER CONNECTION
DETAIL VIEW

SEE NOTE 2

NOTES:

1. TERMINAL WIRE RANGE: 4-14 AWG.
2. TERMINAL SCREW TIGHTENING TORQUE: 16 IN.LBS.
3. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS.
4. FILTER INCLUDES: CAP-511SW (QTY. 1) AND CMB-006(QTY. 1).

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION			
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION			
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		 N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253.8200		SINEWAVE NEXUS FILTER 45A 480V 60Hz OPEN PANEL			
				DRAWN		DATE	
				MN		03/21/19	
				CHECKED		DATE	
		MN		11/21/19			
		APPROVED		DATE			
		RH		12/02/19			
				SIZE	DWG No.	REV	
				D	CD SWNM0045D	01	
				SCALE	1:2	SHEET 1 OF 1	