

APPROX. WEIGHT  
(LBS)  
78

D

C

B

A

FRONT VIEW  
(PANELS REMOVED)

SIDE VIEW

BOTTOM VIEW


TOP VIEW  
(PANELS REMOVED)

SECTION A-A  
CUSTOMER CONNECTION  
DETAIL VIEW AT PANEL



DETAIL B  
CUSTOMER CONNECTION  
DETAIL VIEW

NOTES:

1. TERMINAL WIRE RANGE: 4-18 AWG.
2. TERMINAL WIRE RANGE: 4-14 AWG.
3. TERMINAL SCREW TIGHTENING TORQUE: 16 IN/LBS.
4. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS


THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION		
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION		
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE:  ANGLES: ± 1 °  1 PLACE .X: ± .1 [2.5]  2 PLACE .XX: ± .03 [0.76]  3 PLACE .XXX: ± .010 [0.254]	<div> <b>POWER QUALITY. SOLVED.</b></div> <div>N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253.8200</div>	DRAWN	DATE	SINEWAVE NEXUS FILTER 5A 480V 60Hz NEMA 3R ENCL		
		MN	03/21/19			
		CHECKED	DATE			
		MN	11/19/19			
		APPROVED	DATE	SIZE	DWG No.	REV
		RH	11/26/19	D	CD SWNW0005D	03
				SCALE	5:16	SHEET 1 OF 1

ECO No	DESCRIPTION	REV BY	DATE
M12093	REPLACE CMP W/CMB	MN	11/19/19

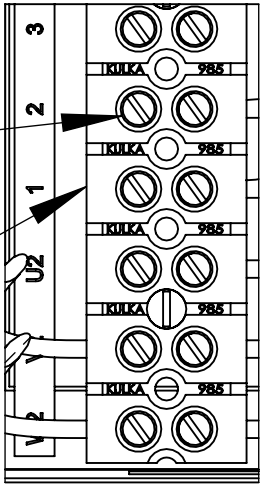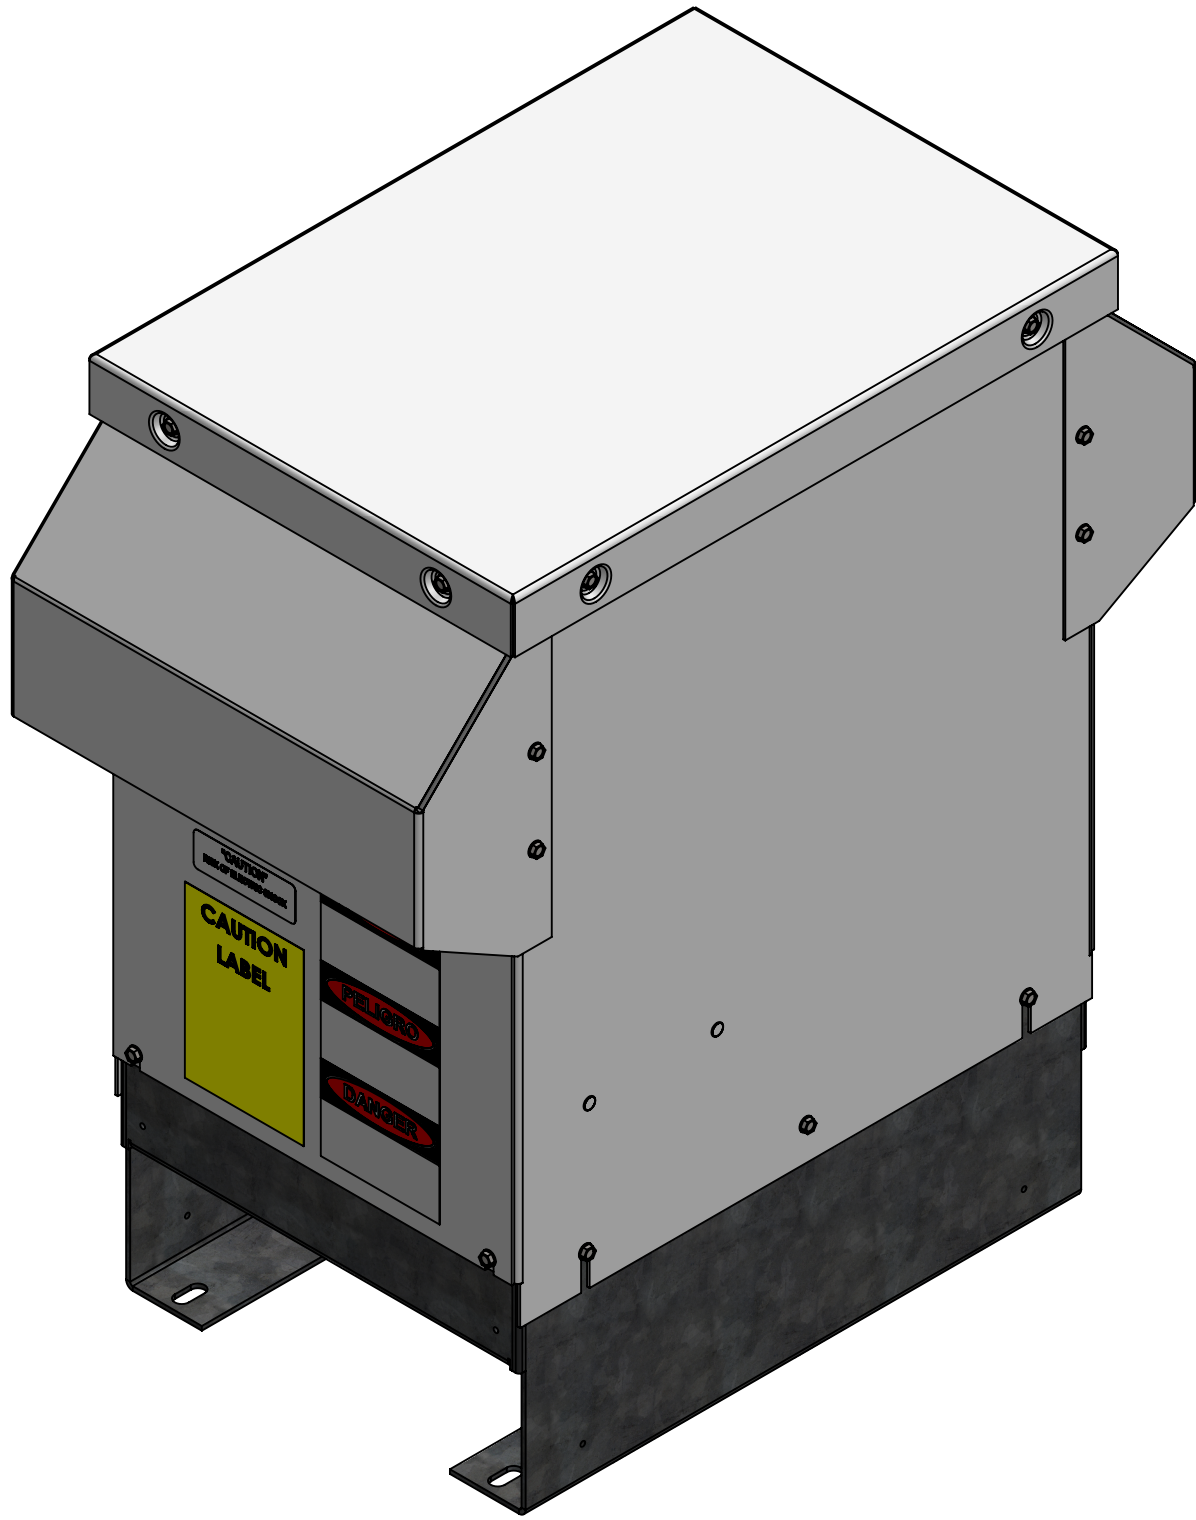



SEE NOTE 3

SEE NOTE 1

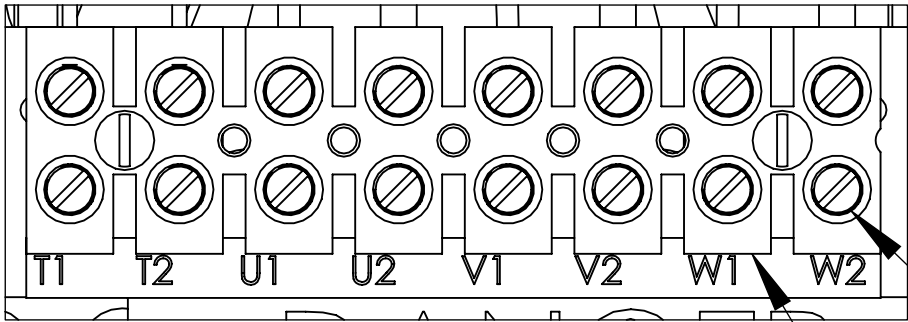

SEE NOTE 3

SEE NOTE 2

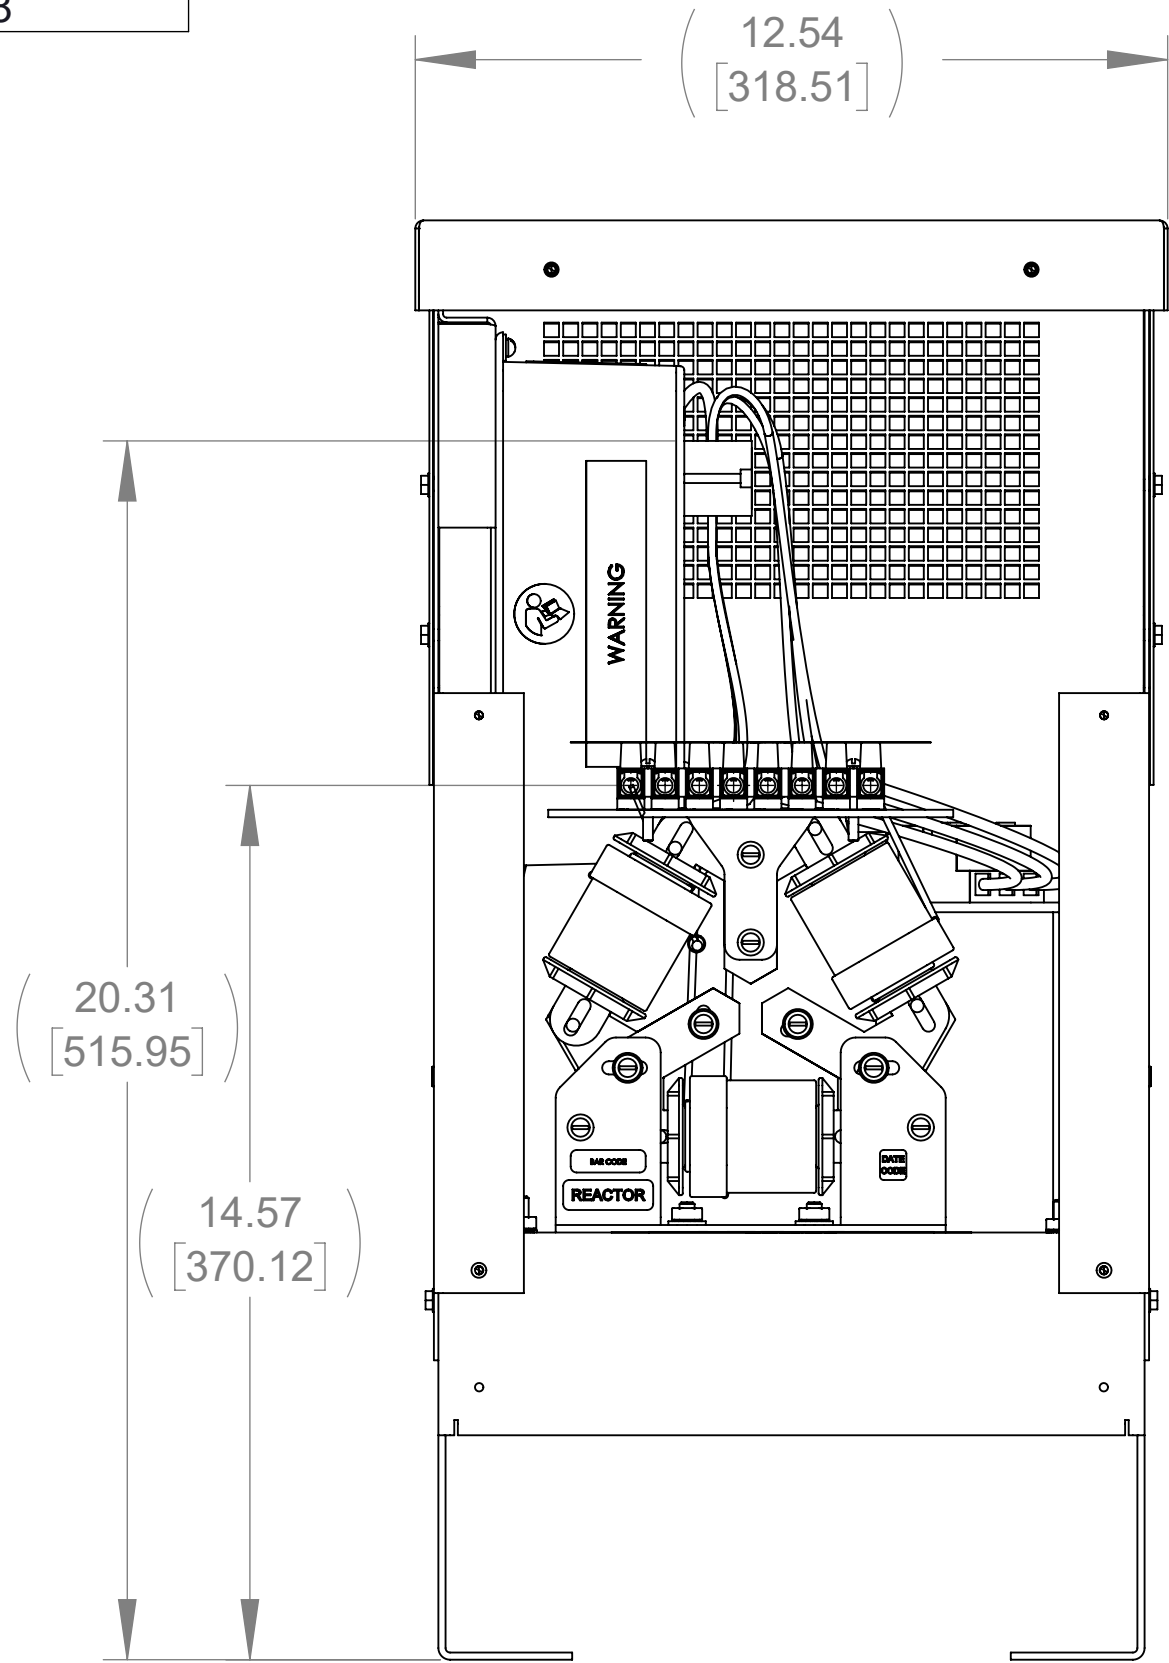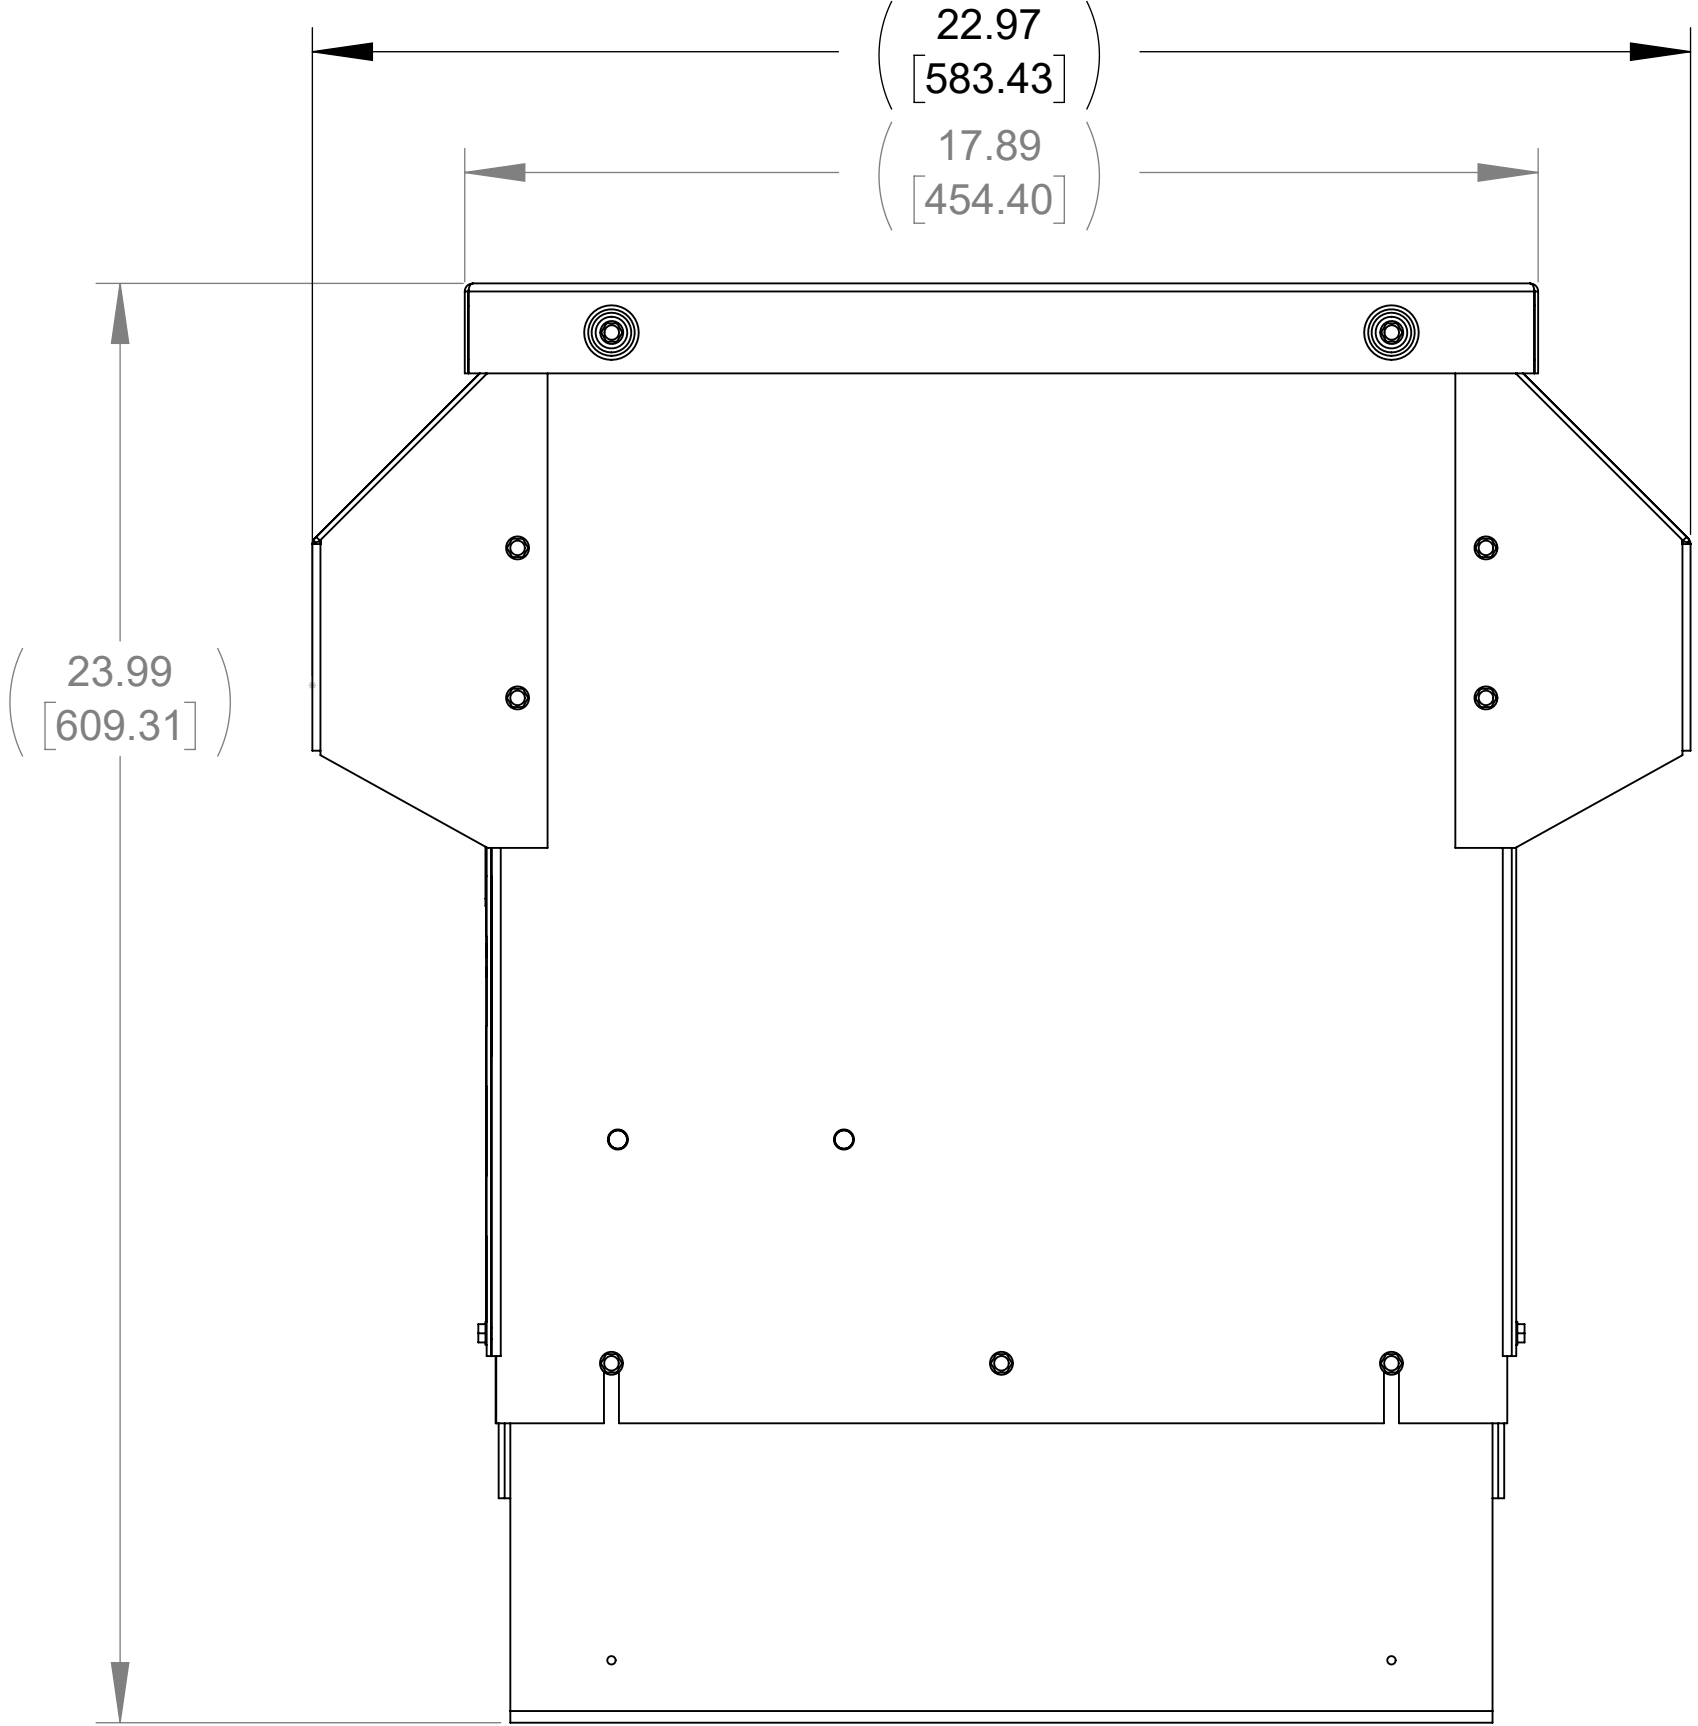

Ø.41 [10.41] X .88 [22.35]  
SLOT, 4 PLACES

1/4-20 GROUND STUD

