

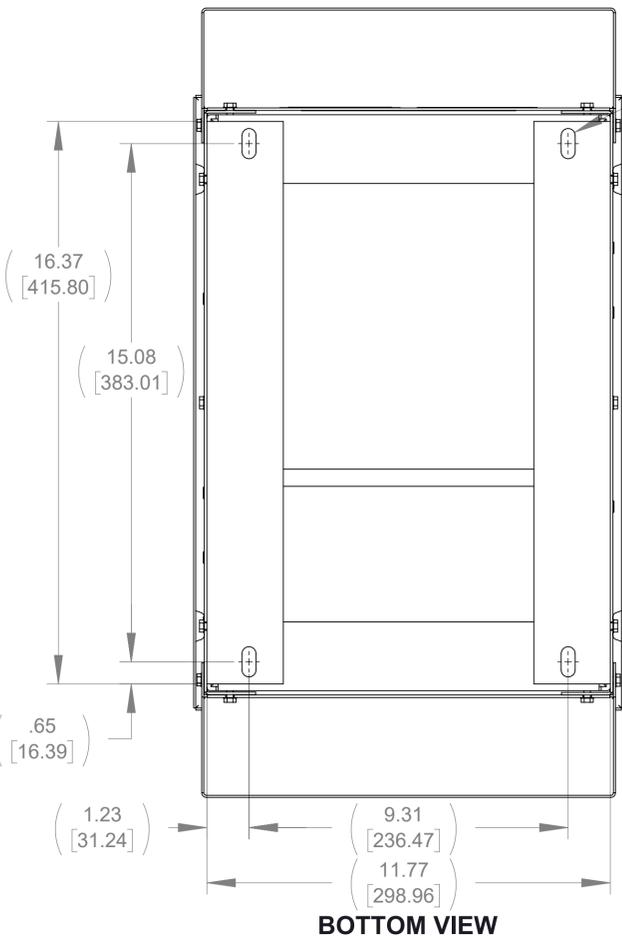
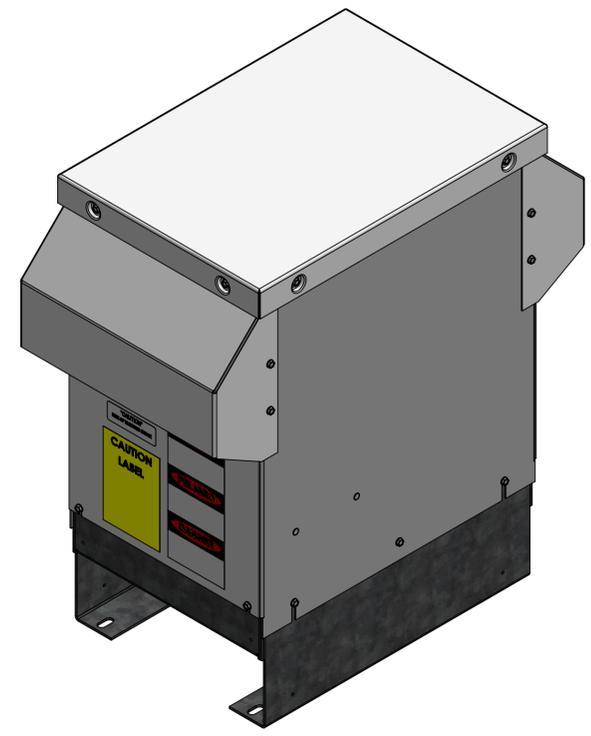
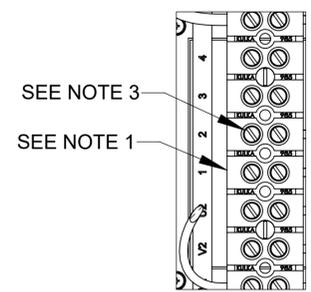
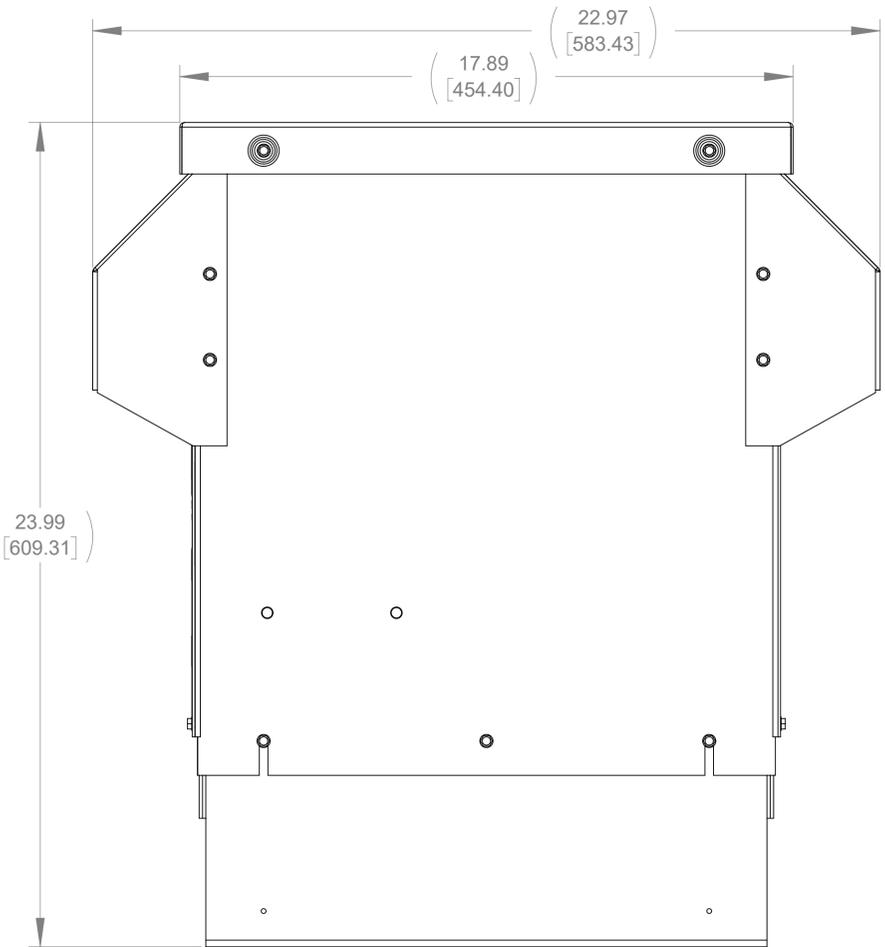
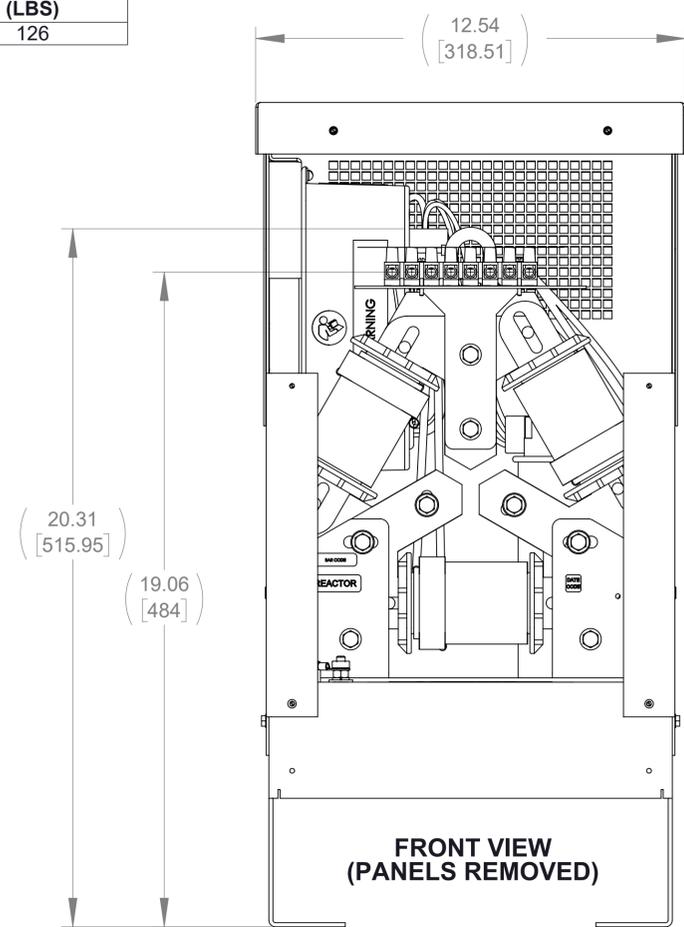


APPROX. WEIGHT (LBS)
126

ECO No	DESCRIPTION	REV BY	DATE
M12094	MOVED INTO SMALLER CABINET, REPLACE CMP W/CMB	MN	11/21/19

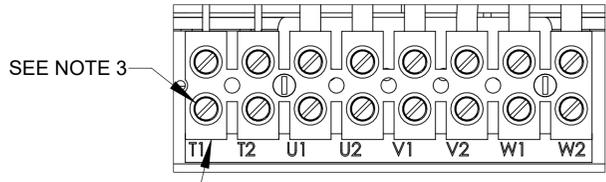

(ϕ .41 [10.41] X .88 [22.35])
SLOT, 4 PLACES

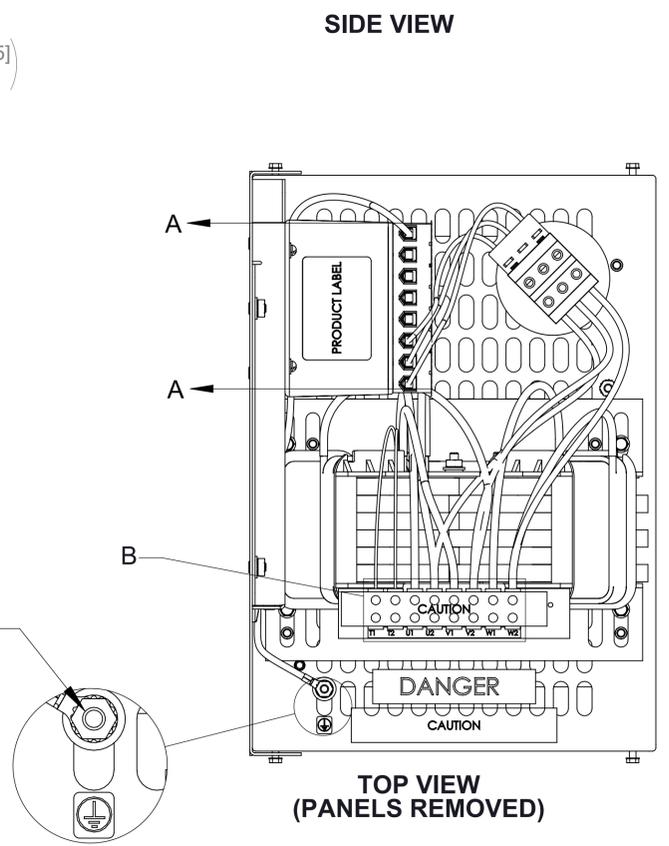

NOTES:

1. TERMINAL WIRE RANGE: 4-18 AWG.
2. TERMINAL WIRE RANGE: 4-14 AWG.
3. TERMINAL SCREW TIGHTENING TORQUE: 16 IN/LBS.
4. REFER TO USER MANUAL FOR COMPLETE INSTALLATION INSTRUCTIONS

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU (EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION	
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE:		DRAWN MN		DATE 06/17/19	
ANGLES: $\pm 1^\circ$		CHECKED MN		DATE 11/21/19	
1 PLACE .X: $\pm .1$ [2.5]		APPROVED RH		DATE 12/02/19	
2 PLACE .XX: $\pm .03$ [0.76]		SIZE D		DWG No. CD SWNW0045D	
3 PLACE .XXX: $\pm .010$ [0.254]		SCALE 3:8		REV 01	
		MTE POWER QUALITY. SOLVED. N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455.4683 262.253.8200		SHEET 1 OF 1	